

Efficiency Of Bacterial Disinfection

By A

Duct Mounted UV-Aire[®] Air Purifier

By:

Kane Environmental Assays
Sanitary & Environmental Microbiology

Bernard E. Kane, Ph.D.
1706 Canterbury Rd
Greenville, NC 27858
Ph. 252.355.6789
Oysterdoctor@aol.com

For:



FIELD CONTROLS
THE VENTING SOLUTIONS COMPANY

Field Controls, LLC • 2630 Airport Road • Kinston, NC 28504
Phone: (252)522-3031 • Fax: (252)522-0214 • Web: www.fieldcontrols.com

Table of Contents

| | |
|--|-----|
| Background | 3 |
| <i>Organism</i> | 3 |
| <i>Testing Structure</i> | 3 |
| <i>Testing Airflow Rate</i> | 3 |
| <i>Organism Applicator</i> | 4 |
| <i>UV Device</i> | 4 |
| <i>Air Sampling Method</i> | 4 |
| Test Apparatus | 4 |
| Testing Procedure | 5 |
| Tables..... | 6-7 |
| <i>Table 1: Control Data</i> | 6 |
| <i>Table 2: UV-18 Test Data Results</i> | 6 |
| <i>Table 3: UV-18X Test Data Results</i> | 7 |
| Conclusion..... | 8 |

Background

This product study evaluates the effectiveness of the UV-Aire air purifier in reducing the levels of bacteria with a single pass through a simulated air duct system. This device is designed to irradiate the air as it circulates through the home, so the single pass evaluation is the worst-case scenario use of this device. The air in the home will pass through the heating and air conditioning system many times a day, as the air is circulated throughout the home. Knowing the effectiveness of the UV-Aire in a single pass application, enables us to project how effectively the device will treat the air with multiple passes a day.

UV light technology has been successfully used for the disinfection of drinking water for years. Applications for air disinfection with the use of UV light technology include: commercial air treatment in hospitals, clean rooms, meat packing plants, bakeries, dairies, breweries, bottling plants and large commercial HVAC systems.

ORGANISM:

Serratia marcescens (ATCC 14756) was chosen as the test bacterium. The distinctive red colonies made it easy to evaluate from any background organisms. A raw test suspension of the organism of approximately 95,000 CFU/ml was used. As dispersed into the test system, this suspension yielded bacterial counts of 269 CFU/ft³ @ 500 ft/min airflow and 107.5 CFU/ft³ @ 1000 ft/min airflow. (CFU = Colony Forming Units)

TESTING STRUCTURE:

An 18" x 18" galvanized air duct, 38 feet long was constructed as the test chamber (see Figure 1). A fan was mounted at the exit end of the chamber and the treated air exhausted to the outdoors. To reduce contamination of the intake air, all air intakes on the exhaust side of the building were sealed. The exhaust fan was equipped with a flow adjustment to allow for adjustable air speeds measured in feet per minute (FPM) through the duct.

TESTING AIRFLOW RATE:

The airflow rate through the ductwork was adjusted to two nominal velocities of 500 ft/min and 1000 ft/min. The airflow velocities were measured at the center of the duct at the intake end of the test duct.

ORGANISM APPLICATOR:

An atomizing humidifier spray nozzle mounted at the center of the test duct intake was used to distribute the organism into the air stream. The application flow rate was 0.45 gallons per hour.

UV DEVICE:

A Field Controls UV-Aire air purifier model UV-18 was mounted onto the center of the side of the test duct 6 feet from the exit end of the chamber. The lamp is a UVC germicidal lamp (non ozone producing) 18 inches long with a UV output rating of 73 $\mu\text{W}/\text{cm}^2$ at 1 meter from the lamp.

AIR SAMPLING METHOD:

An Andersen N6 single stage “bioaerosol” sampler was used to take the air samples and distribute the sampled air onto agar medium. The test medium was Tryptic Soy Agar from PathCon, Inc. The air sampling pump airflow rate was 1 CFM.

The Anderson sampler method requires corrections to the actual colony counts on the plates. This provides a more accurate measure of the bacteria per cubic foot of the sample air. In the following tables, the *Serratia marcescens* Positive Hole Count values are the actual plate counts and the Corrected Particle Count values are corrected value based on Anderson correction tables.

Test Apparatus

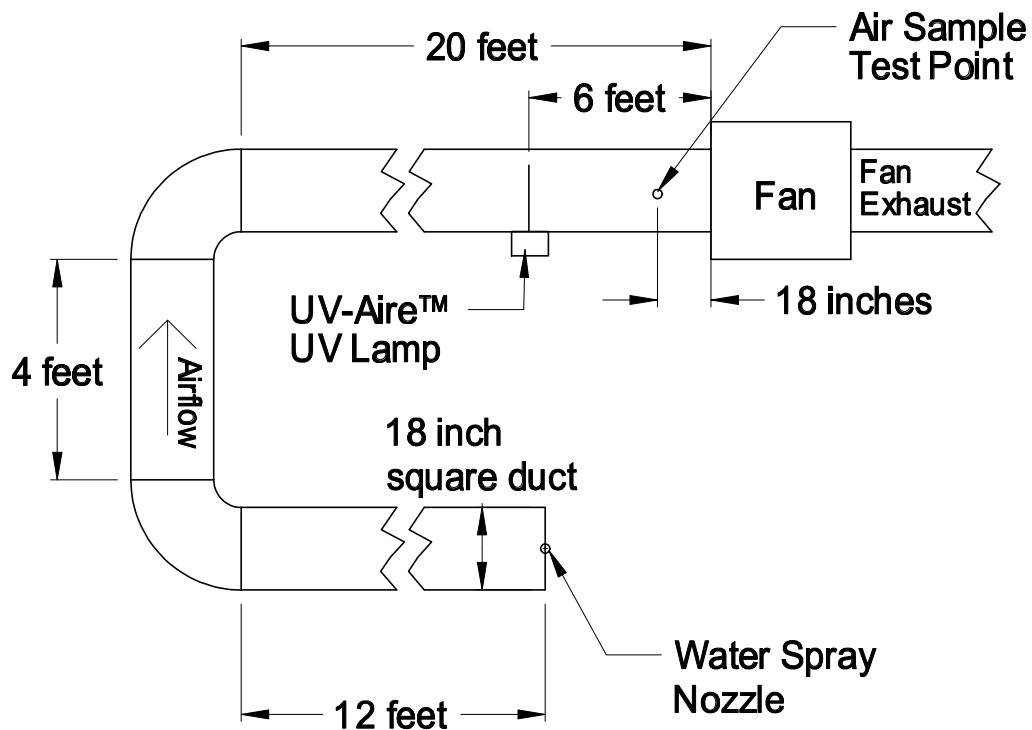


Figure 1

Testing Procedure

The testing was performed in two stages. The first stage operated the test chamber with the lamp off. (See table 1) This developed the control data or the base line bacterial levels for the comparison. The second stage operated the test chamber with the lamp on. (See table 2)

Two airflow rates were used to evaluate the lamp effectiveness based on exposure time. Airflow velocities through the ducts of a typical residential heating and cooling system range from 300 to 500 feet per min (fpm). For this study a base air velocity of 500 fpm was used. To decrease the exposure time, a second test was conducted with the airflow in the duct doubled to 1000 fpm. Since the effectiveness of UV lamps is based on the UV light output and exposure time, doubling the airflow reduces the effectiveness of the lamp.

The bacterium was cultured and the cells harvested to provide a suspension of known cell density. This was further diluted to provide gallon quantities of a test suspension containing an estimated 95,000 CFU/ml. This suspension was pumped through the spray nozzle mounted in the center of the duct inlet.

Five air samples were taken for each of the test velocities at short intervals (typically ½ to 2 minutes). This produced a large sample volume of air and reduced the levels of background bacteria and molds counts. The plate counts (colony forming units or CFU) for each of the five tests were totaled and divided by the total test volume of air. This produced the comparison value of (269 CFU/FT³ of air) for the 500 FPM airflow and (107.5 CFU/FT³ of air) for the 1000 FPM airflow. Due to apparent efficiency losses in the sampling method at the 1000 FPM velocity, the bacterium count yielded a 60% drop instead of the anticipated 50% reduction due to the velocity change.

Four air samples were taken at 1, 2.5, 3, 5, 6 & 10 minute intervals for each of the test velocities with the lamp on. The longer sample times with the lamp on were needed to obtain plate counts which would provide reliable estimates of the efficiency of disinfection, but with this, more background organisms were found. The plate counts were (18.00 CFU/FT³ of air for the UV-18 and 2.56 CFU/FT³ of air for the UV-18X) at 500 FPM airflow. They were 31.18 CFU/FT³ of air for the UV-18 and 10.40 CFU/FT³ of air for the UV-18X at 1000 FPM airflow.

Table 1: Control Data (testing with lamp off)

| Sample Number | Air Sampling Duration (min) | Airflow Velocity fpm | <i>Serratia marcescens</i> Positive hole count | Corrected Particle Counts | CFU/FT ³ of air (count/min) |
|-----------------------|-----------------------------|----------------------|--|---------------------------|--|
| 1 | 1 | 500 | 181 | 241 | |
| 2 | 1 | 500 | 193 | 263 | |
| 3 | 1 | 500 | 208 | 294 | |
| 4 | 0.5 | 500 | 117 | 138 | |
| 5 | 0.5 | 500 | 118 | 140 | |
| Total min. = 4 | | | Total Corrected Particle counts = 1076 | | 269.00 |
| 1 | 2 | 1000 | 168 | 218 | |
| 2 | 2 | 1000 | 167 | 216 | |
| 3 | 2 | 1000 | 169 | 220 | |
| 4 | 1 | 1000 | 91 | 103 | |
| 5 | 1 | 1000 | 92 | 103 | |
| Total min. = 8 | | | Total Corrected Particle counts = 860 | | 107.50 |

Table 2: UV-18 Test data and results (testing with lamp on)

| Sample Number | Air Sampling Duration (min) | Airflow Velocity (fpm) | <i>Serratia marcescens</i> Positive hole count | Corrected Particle Counts | CFU/FT ³ of air (count/min) | %Survival CFU/Control | Log Reduction | % Effective |
|-----------------------|-----------------------------|------------------------|--|---------------------------|--|-----------------------|---------------|-------------|
| 1 | 1 | 1000 | 30 | 31 | | | | |
| 2 | 1 | 1000 | 32 | 33 | | | | |
| 3 | 3 | 1000 | 88 | 99 | | | | |
| 4 | 6 | 1000 | 145 | 180 | | | | |
| Total min = 11 | | | Total Corrected Particle Counts = 343 | | 31.18 | 29.01 | 0.54 | 70.99 |
| | | | | Control: | 107.50 | | | |
| 1 | 1 | 500 | 13 | 13 | | | | |
| 2 | 1 | 500 | 19 | 19 | | | | |
| 3 | 3 | 500 | 57 | 61 | | | | |
| 4 | 6 | 500 | 92 | 105 | | | | |
| Total min = 11 | | | Total Corrected Particle Counts = 198 | | 18.00 | 6.69 | 1.17 | 93.31 |
| | | | | Control: | 269.00 | | | |

Table 3: UV-18X Test data and results (testing with lamp on)

| Sample Number | Air Sampling Duration (min) | Airflow Velocity (fpm) | <i>Serratia marcescens</i> Positive hole count | Corrected Particle Counts | CFU/FT ³ of air (count/min) | %Survival CFU/Control | Log Reduction | % Effective |
|-------------------------|-----------------------------|------------------------|--|---------------------------|--|-----------------------|---------------|-------------|
| 1 | 2.5 | 1000 | 21 | 22 | | | | |
| 2 | 2.5 | 1000 | 27 | 28 | | | | |
| 3 | 2.5 | 1000 | 28 | 29 | | | | |
| 4 | 5 | 1000 | 48 | 51 | | | | |
| Total min = 12.5 | | | Total Corrected Particle Counts = 130 | | 10.40 | 9.67 | 1.01 | 90.33 |
| | | | | Control: | 107.50 | | | |
| 1 | 5 | 500 | 8 | 8 | | | | |
| 2 | 5 | 500 | 10 | 10 | | | | |
| 3 | 5 | 500 | 17 | 17 | | | | |
| 4 | 10 | 500 | 28 | 29 | | | | |
| Total min = 25 | | | Total Corrected Particle Counts = 64 | | 2.56 | 0.95 | 2.02 | 99.05 |
| | | | | Control: | 269.00 | | | |

Conclusion

| UV-Aire Model | Airflow velocity (fpm) | Percent Reduction of Bacteria | Percent Survival of Bacteria | Log Reductions of Bacteria |
|---------------|------------------------|-------------------------------|------------------------------|----------------------------|
| UV-18 | 500 | 93.31 | 6.69 | 1.17 |
| UV-18 | 1000 | 71.99 | 29.01 | 0.54 |
| UV-18X | 500 | 99.00 | 0.95 | 2.02 |
| UV-18X | 1000 | 90.33 | 9.67 | 1.01 |

The testing showed the UV-Aire lamp yields at least a 90% reduction of the test bacteria with a single airflow pass through a duct system at typical airflow rates. This efficiency will not be the same for all bacteria and molds since each organism requires different exposure times at the same UV output energy level.

At the higher velocity, the lamp still reduced the bacterial levels by at least 71 % at a 50% decrease in the exposure time. Since the reduction efficiency is based on lamp UV output and exposure time, the assumption can be made that decreasing the exposure time to the UV light is similar to testing an organism that requires a higher UV energy requirement to kill the bacteria. The log reductions in bacterial levels were very close to theoretical values. Within the limits of testing accuracy, twice as many log reductions (0.54 vs. 1.17 and 1.01 vs. 2.02) occurred with twice the exposure time.

This testing and the results clearly show that the exposure of the air to the UV light of the UV-Aire will reduce levels of airborne bacteria.