


COMBUSTION AIR SYSTEM

Model: CAS-3

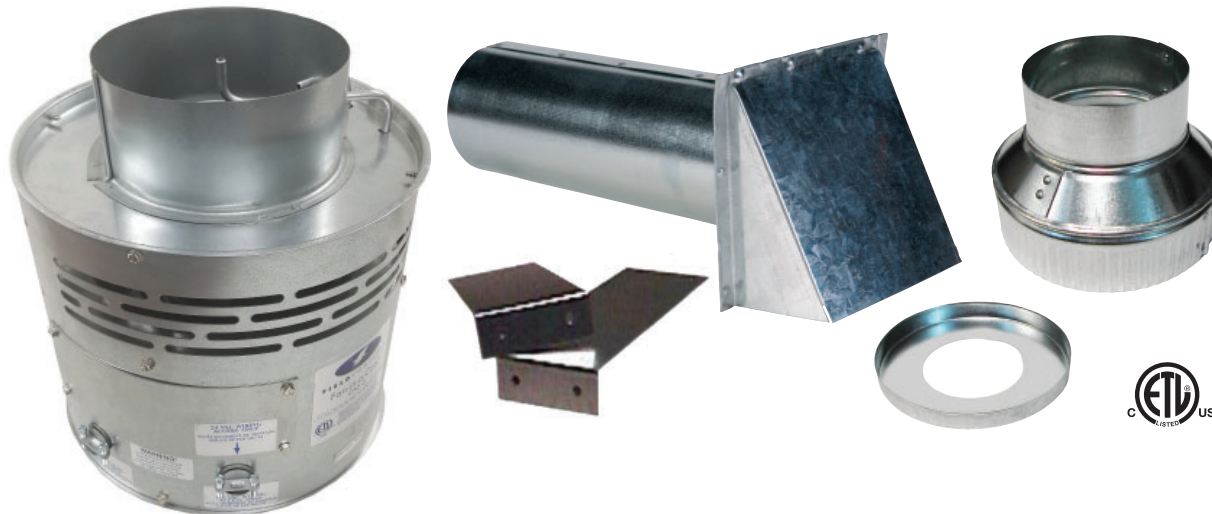

This product is designed for use with any oil burning furnace, water heater, or boiler with 120 VAC control systems. The CAS-3 may be used with one 120V-controlled combustion heating appliance and one 30mV standing-pilot gas water heater with the use of an additional CK-20 series control kit. Additional 120V or 24V-controlled appliances may also be served by the CAS-3 with the addition of one CAC-120 or CAC-24 control kit per each additional appliance (see note)*. The CAS unit mechanically draws air into a structure and disperses it near the combustion air intake of an appliance. Refer to Diagram A and B for guidance in setting up the CAS system based on the size and length of the connecting ductwork and the input rating of the appliance.

ITEMS INCLUDED IN KIT:

- | | |
|--|---------------------------------------|
| 1- Motorized Blower | 1- 4" galvanized intake air Vent Hood |
| 2- Mounting Brackets to secure the CAS to a wall | 2- Wire/Conduit connectors |
| 1- 4" x 6" Pipe Increaser Fitting | 1- 6" Orifice Ring |
| 1- Instruction Sheet | 1- High/Low Motor Speed Switch |



WARNING! CONNECTIONS TO MULTIPLE APPLIANCES MUST FOLLOW INSTALLATION INSTRUCTION WIRING DIAGRAMS. FOR HELP CALL 1-800-742-8368.

*NOTE: The model CAS-3 has recently been changed to comply with pending revisions to installation standard NFPA-31. Please note that there are differences in construction, operation, and installation of this CAS as compared to legacy product. Also, note that for multiple appliance installations, each additional appliance will require either a CAC-24 or CAC-120 control kit be provided for that appliance. Installations with one heating appliance and one 30mV gas water heater will require an additional CK-20 series control kit in addition to the CAS-3.

READ THESE INSTRUCTIONS CAREFULLY AND COMPLETELY BEFORE PROCEEDING WITH THE INSTALLATION.

This device **MUST** be installed by a qualified agency in accordance with the manufacturer's installation instructions. The definition of a qualified agency is: any individual, firm, corporation or company which either in person or through a representative is engaged in, and is responsible for, the installation and operation of HVAC appliances, who is experienced in such work, familiar with all the precautions required, and has complied with all the requirements of the authority having jurisdiction.

Please retain these instructions after installation.

Installed By: _____ Phone: _____ Installation Date: _____



FIELD CONTROLS

www.fieldcontrols.com

P/N 46261200 Rev M 09/19

(THIS PAGE LEFT INTENTIONALLY BLANK)

GENERAL SYSTEM OPERATION

1. The thermostat (wall thermostat, or aquastat) calls for heat and energizes a relay which activates the CAS unit. After the CAS fan has come up to speed and air flow into the CAS inlet is established, an internal air pressure switch closes and completes the circuit to allow the burner to fire. If the appliance is power vented, the venter and CAS activate simultaneously. After the CAS and power venter have come up to speed, a pressure switch in the power venter control also closes and allows the appliance to fire.
2. After the heating requirement has been satisfied, the thermostat circuit will open and deactivate the burner and CAS unit.
3. For power vented systems with a post purge device, the power venter and CAS operate for a period of time after the burner has shut off to purge remaining flue gases from the vent system.

INSTALLATION SAFETY INSTRUCTIONS

CAUTION: This device must be installed by a qualified installer in accordance with the manufacturer's installation instructions.

1. This combustion air system must be installed by a qualified installer. "Qualified Installer" shall mean an individual who has been properly trained or a licensed installer.
2. Plan the system layout before installation to avoid the possibility of accidental contact with concealed wiring or plumbing inside walls.
3. Disconnect power supply before making wiring connections to prevent electrical shock and equipment damage.

SIZING AND SETUP

Diagrams A and B and Table 1 shows the maximum equivalent length and size of duct pipe that should be used when installing the CAS system. Using these charts will help ensure that the proper amount of air is drawn into the structure as needed by the appliance. The defined regions shown correspond to the CAS's airflow characteristics when using 4" and 6" diameter sheet metal duct pipe and the included orifice ring. Follow the guidelines below to properly size and set up the CAS.

1. Determine the maximum input firing rate of the appliance, or the maximum total firing rate of multiple appliances that will be used.
2. Position the motorized CAS unit according to the guidelines in the "Installation" section.
3. Determine where the intake air vent hood will be located based on the recommendations in the "Installation" section.
4. The CAS is equipped with a High/Low motor speed control switch. When calculating the maximum equivalent feet, determine which speed is appropriate for the application. (Refer to Diagram A or B or Table 1)
5. Calculate the total equivalent length of duct pipe including elbows and fittings needed to connect the CAS unit to the vent hood. (Refer to Diagram A or B or Table 1)
6. On Diagram A or B, locate the point that corresponds to the firing rate along the horizontal axis and the equivalent length of the duct pipe along the vertical axis, if using for Make-Up air.
7. The point should fall within one of the three regions on the table. Each region corresponds to a duct pipe diameter of 4", 4" using the orifice ring, and 6" respectively.

EXAMPLE: An oil fired appliance firing at 1.0 gph where the CAS unit needs to be placed 30 equivalent feet from the intake hood. From Diagram A or B, the point at 1.0 gph on the "Oil Firing Rate" scale and 30 equivalent feet falls in the 4" Duct, Hood, and Orifice Ring region. The point is in between the left and right boundary of the region. The left boundary is the edge of the graph, the right boundary is the diagonal line that says 4" Duct, Hood & Orifice Ring. Therefore, place the Orifice Ring into the inlet on the CAS so that it sits on the ledge above the fan. It does not matter which way the Orifice Ring is turned as long as it is pushed down against the ledge completely. Use 4" diameter pipe to connect the vent hood and the CAS unit. Install included 4" x 6" Increaser on top of the CAS.

Table 1

TOTAL INPUT OF APPLIANCE	MAXIMUM EQUIVALENT FEET OF INSTALLATION					
CAS-3 Oil (gph)	4" Duct And Hood w/ Restrictor		4" Duct And 4" Intake Air Hood		6" Duct And 6" Intake Air Hood	
	HI	LOW	HI	LOW	HI	LOW
0.50	300	300	300	300	300	300
0.75	300	300	300	300	300	300
0.90	300	220	300	220	300	300
1.00	174	108	232	118	300	300
1.25	99	48	152	63	300	300
1.35	52	14	102	32	300	300
1.55	20	NA	68	13	300	239
1.75	NA	NA	45	NA	300	150
2.00	NA	NA	16	NA	300	53
2.50	NA	NA	NA	NA	193	8
2.75	NA	NA	NA	NA	109	NA
3.25	NA	NA	NA	NA	56	NA

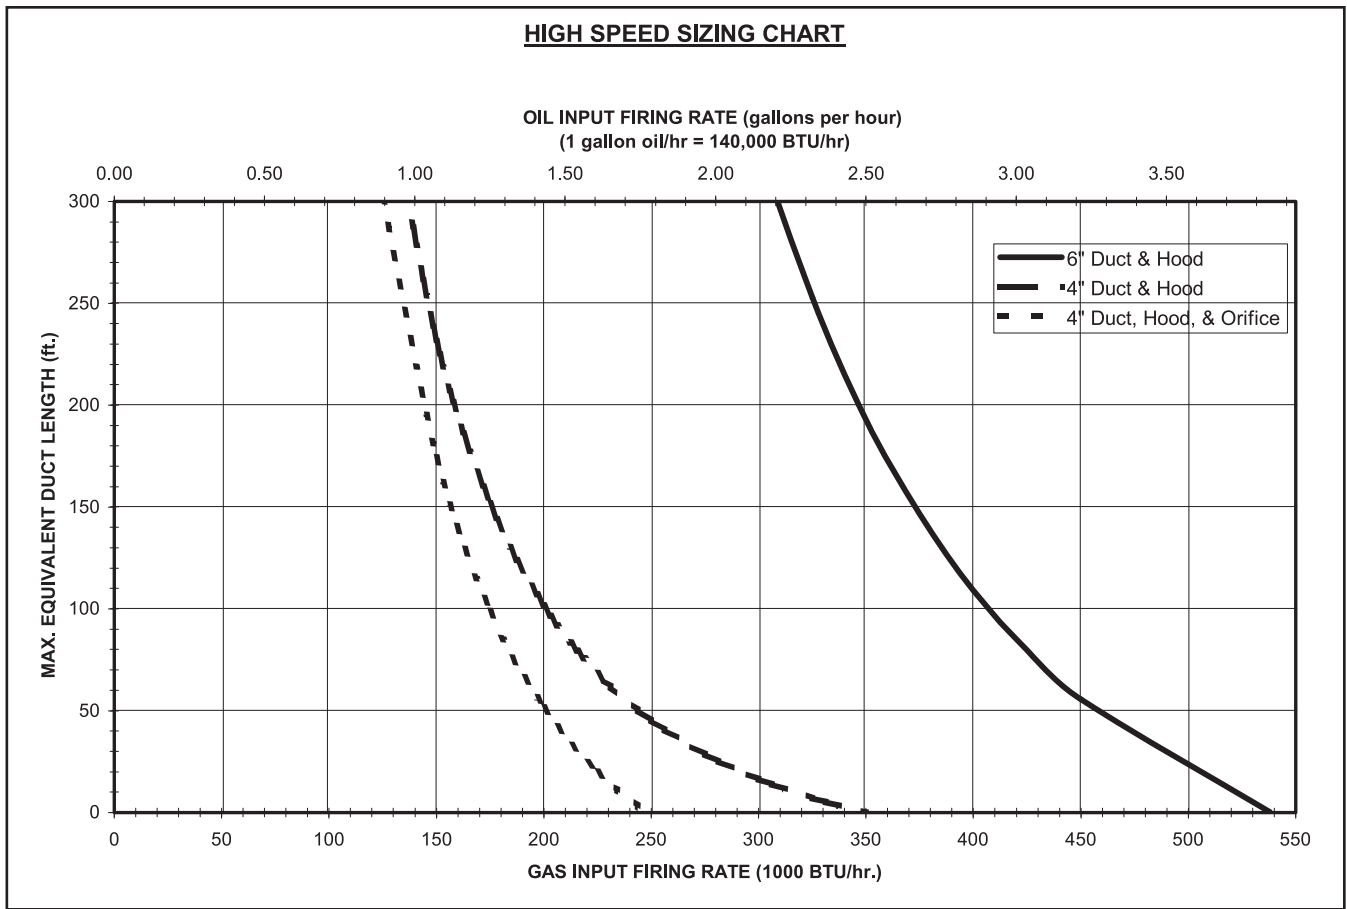


Diagram A

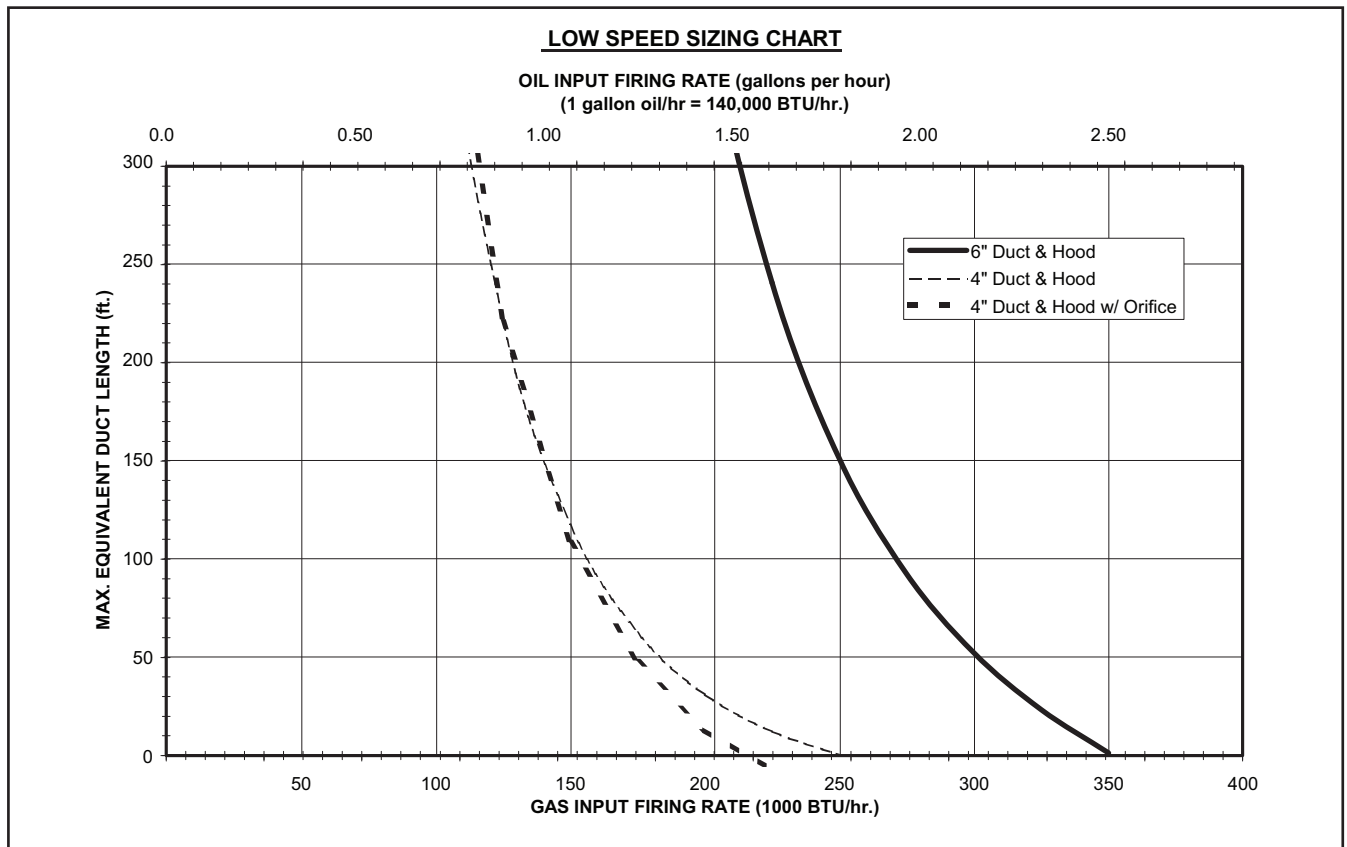


Diagram B

INSTALLATION

PLACEMENT OF THE CAS UNIT

The motorized CAS unit should be located on a flat horizontal surface within the space of the appliance or appliances, and try to be within 3' of the combustion air intake of the appliance. Two mounting brackets are provided for securing the unit against a solid structure, such as a wall, column, or the side of the appliance itself. Use the included screws to attach the brackets to the CAS housing as shown in Figure 1. Secure the brackets to a solid structure with appropriate fasteners. It is not required to use the brackets as long as the unit is located so that it may not be bumped, moved, or tipped over.

INTAKE AIR HOOD LOCATION

The 4" galvanized vent hood should be located on an outside wall maintaining minimum clearances to other intake and exhaust vents in accordance with the National Fuel Gas Code, ANSI Z223.1, manufacturer's recommendations and/or local codes which are applicable. The hood should be located at least 10' from a power vented exhaust outlet and should be on the same wall.

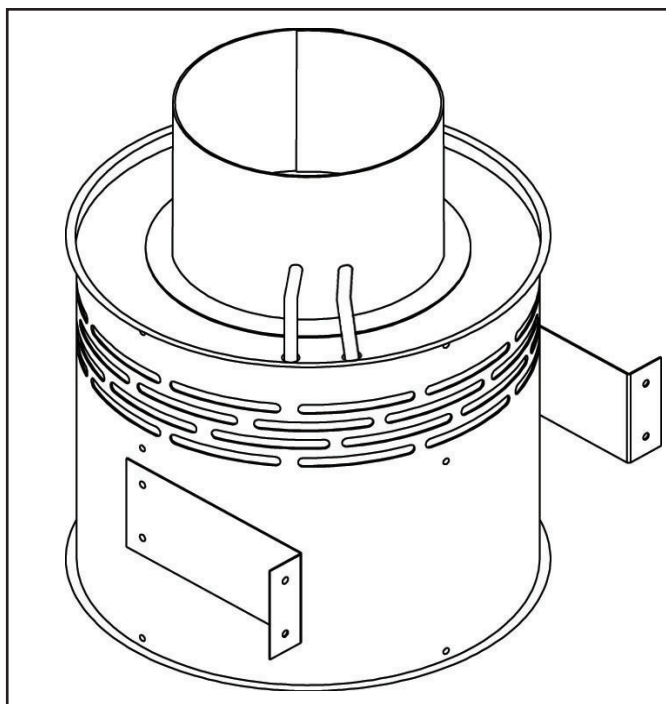


Figure 1

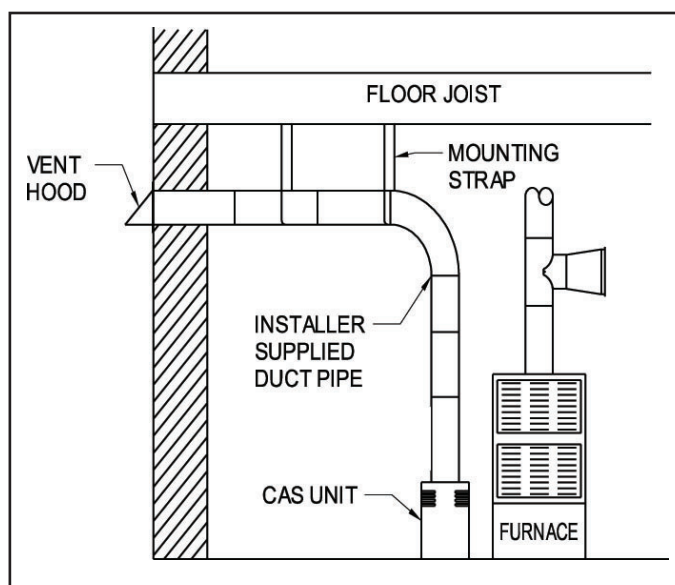


Figure 2

INSTALLATION OF INTAKE AIR HOOD

After determining the location of the vent hood, cut a 4 ½" round or square hole in the wall. Insert the vent hood and secure with appropriate fasteners. Take precautions to avoid interference with wiring or other plumbing in the wall to be cut.

INSTALLATION OF DUCT

Refer to Diagram A or B to determine what size pipe is needed. Connect the duct pipe from the top of the CAS unit to the Vent Hood in the wall. If using 4" diameter pipe attach the provided 4" x 6" Pipe Increaser Fitting to the top of the CAS unit. The duct should be supported with appropriate mounting straps from floor joists, walls, or other solid structures. The straps should be placed so as to keep the ductwork out of passageways. (See Figure 2) A minimum of 12' of pipe should be run to help temper outside air being drawn in.

WIRING INSTRUCTIONS

Wire the CAS unit in accordance with the National Electric Code and applicable local codes. UNIT MUST BE GROUNDED. Check the ground circuit to make certain that the unit has been properly grounded. The wiring should be protected by an over-current circuit device rated at 15 amperes. CAUTION must be taken to ensure that the wiring does not come in contact with any heat source. All line voltage and control circuits between the CAS unit and the appliance MUST be wired in accordance with the National Electrical Code for Class I wiring or equivalent.

Remove the wiring access cover to access the wiring terminals. Use the enclosed conduit connector(s) to route the appropriate wires through the CAS housing. The incoming ground wire must be attached to the green colored ground screw near the wire terminals. The following sections describe the most common applications. The references to various series of control kits implies that any kit in that series may be used.If further information or additional wiring diagrams are needed please consult Field Controls’ technical support.



WARNING! CONNECTIONS TO MULTIPLE APPLIANCES MUST FOLLOW INSTALLATION INSTRUCTION WIRING DIAGRAMS. FOR HELP CALL 1-800-742-8368.

INTERNAL WIRING CONNECTIONS FOR THE CAS UNIT

Refer to Figure 3 for the internal wiring of the CAS-3 unit.

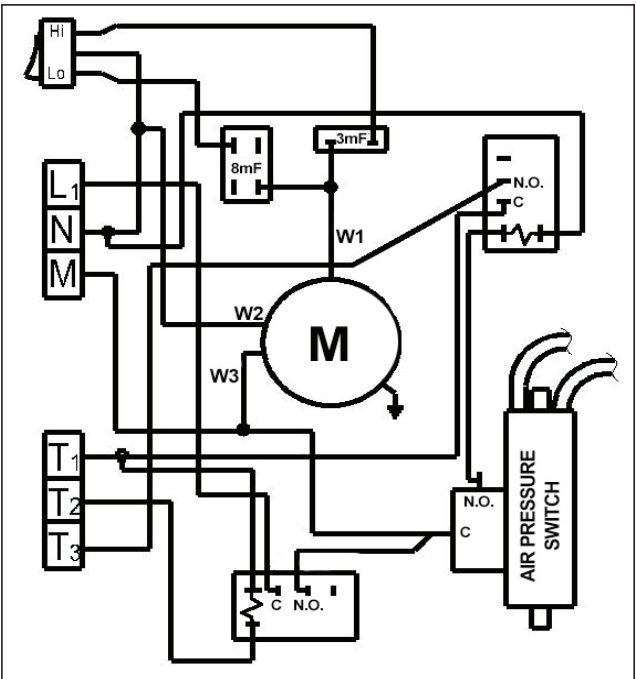




Figure 3

WIRE KEY	WIRE COLOR		
Motor Manufacturer	W1	W2	W3
McLean Engineering	Black	Blue	Brown
All Others	Brown	Black	Blue

Refer to Figures 4-7 for appropriate wiring method.



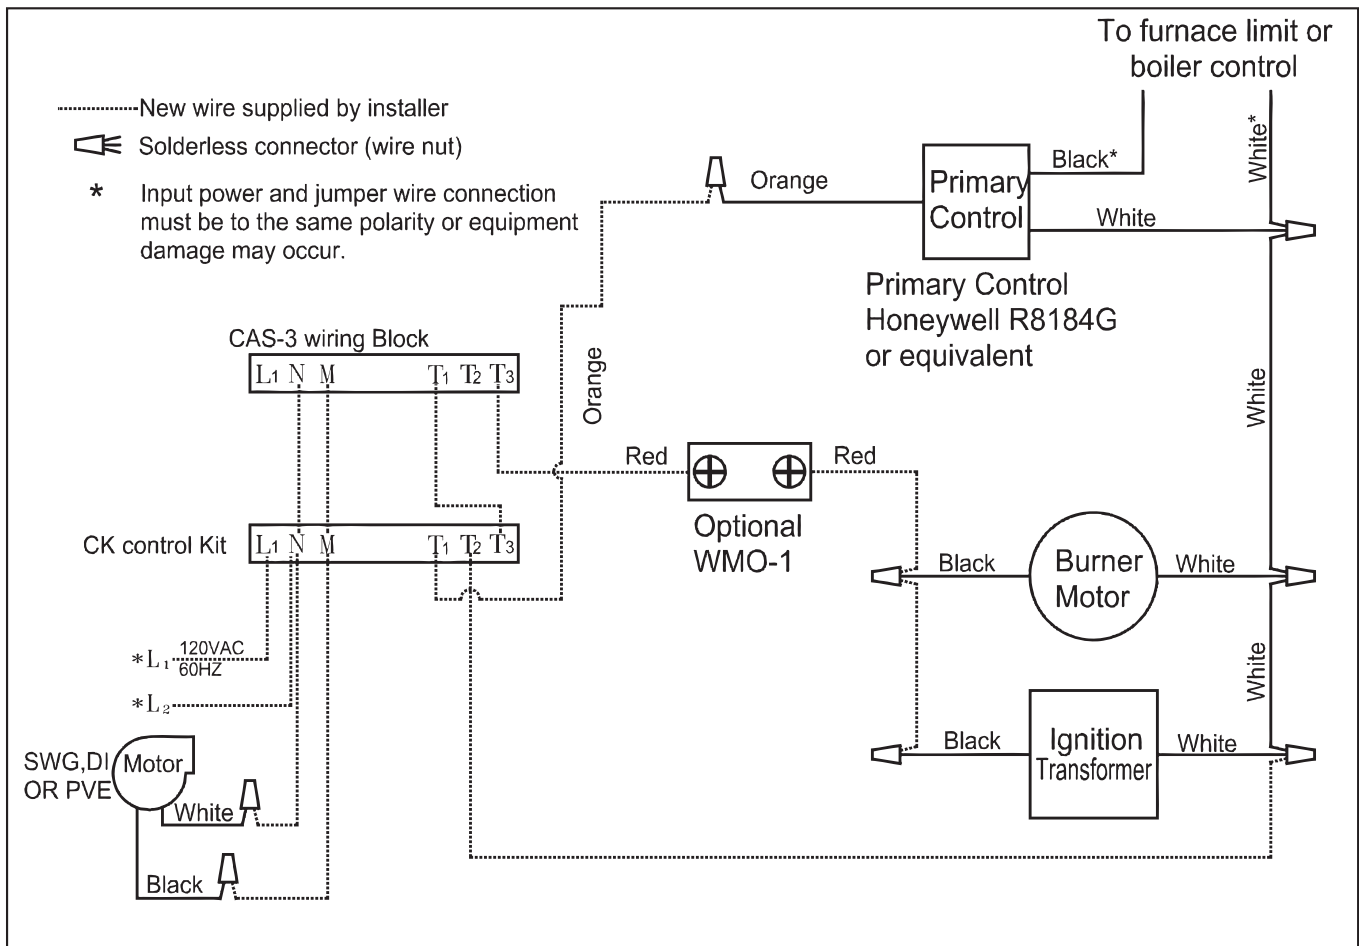


Figure 6- Single Vent Oil Fired System

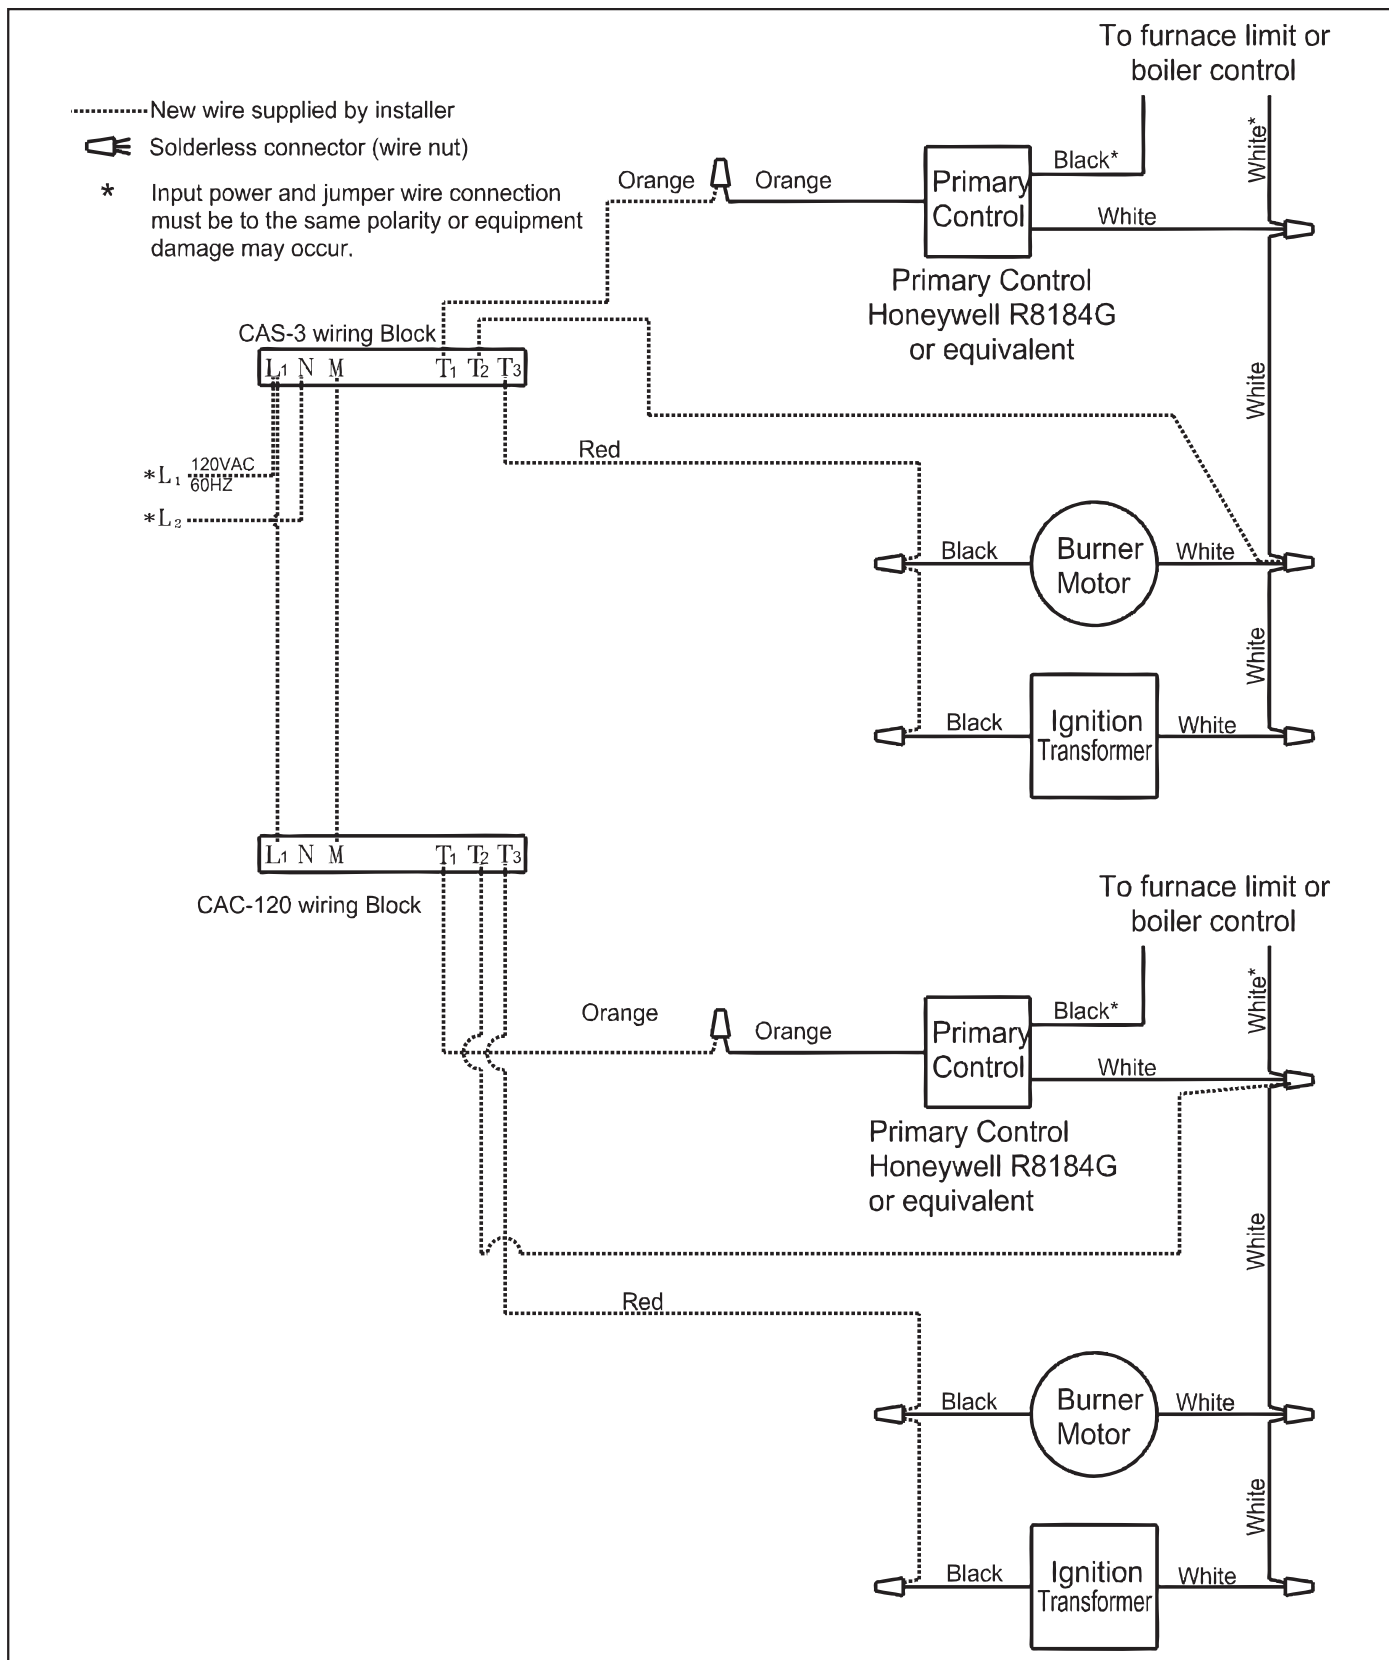


Figure 7- Chimney Vent Two Oil Fired System with CAC-120

MAINTENANCE

1. Inspect the system annually to ensure proper operation by observing that the fan activates when a call for heat occurs and deactivates when a call for heat is satisfied.
2. Disconnect power to the CAS unit and repeat Step 1. Note: The unit should not run and the appliance should not fire in this condition.
3. Inspect the duct pipe for cracks and security to the CAS unit and vent hood. The CAS unit will not allow the appliance(s) to fire if inadequate air flow is allowed into the inlet of the CAS.
4. Clear any obstructions, if present, from the inlet of the vent hood and the outlet of the CAS unit.
5. Periodically, the fan blade chamber may need cleaning. First, disconnect the power supply to the CAS. Next, disconnect the duct pipe from the unit. Then remove the top pan and clean the fan housing area as needed. Reattach the top pan, reconnect the duct pipe and the power supply.

REPLACEMENT PARTS

The following items are available for replacement, if needed. In order to replace these parts, power must be disconnected and the unit must be disassembled. If this is necessary, take note of the positions and locations of whatever items that may need to be removed to replace other items. If in doubt, please consult the Field Controls Technical Support at 1-800-742-8368.

ITEM DESCRIPTION	FIELD PART NUMBER
Motorized Fan	46274100
Switch Pressure Fxd CAS-4TMR	511100200
120 VAC Relay for CAS-3	46257300

This manual may be downloaded and printed from the Field Controls website (www.fieldcontrols.com)

WARRANTY

For warranty information about this or any Field Controls product, visit:
www.fieldcontrols.com

Field Controls Technical Support
1.800.742.8368
fieldtec@fieldcontrols.com



FIELD CONTROLS

Phone: 252.522.3031 • Fax: 252.522.0214
www.fieldcontrols.com