


# MOUNTING LOCATION DIAGRAMS

Model: GSK-3 SPILL SWITCH


Mounting location on an MG-1 4" - 9" Barometric draft control



LOCATION FOR FASTEST RESPONSE –  
OPTIONAL LOCATION

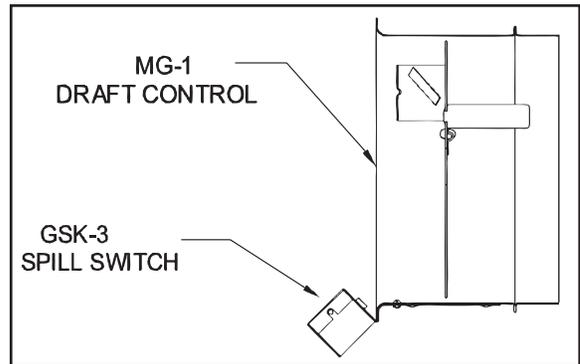

LOCATION FOR SLOWER RESPONSE

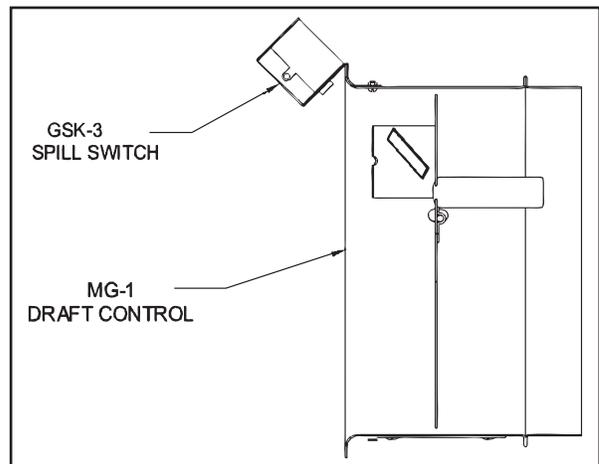

Refer to GSK-3 Instruction Sheet for Mounting and Wiring Information.

## GSK-3 SPILL SWITCH SPECIFICATION

Switching Voltage	Millivolts Or 24VAC
Switch Open Temperature	180° F
Switch Type	Normally Closed Manual Reset

READ THESE INSTRUCTIONS CAREFULLY AND COMPLETELY BEFORE PROCEEDING WITH THE INSTALLATION.

This device **MUST** be installed by a qualified agency in accordance with the manufacturer's installation instructions. The definition of a qualified agency is: any individual, firm, corporation or company which either in person or through a representative is engaged in, and is responsible for, the installation and operation of HVAC appliances, who is experienced in such work, familiar with all the precautions required, and has complied with all the requirements of the authority having jurisdiction.

Please retain these instructions after installation.

Installed By: \_\_\_\_\_ Phone: \_\_\_\_\_ Installation Date: \_\_\_\_\_



**FIELD CONTROLS**

www.fieldcontrols.com

## **WARRANTY**

For warranty about this or any Field Controls product, visit:  
[www.fieldcontrols.com/warranty](http://www.fieldcontrols.com/warranty)



**FIELD CONTROLS**

Phone: 252.522.3031 • Fax: 252.522.0214  
[www.fieldcontrols.com](http://www.fieldcontrols.com)