SYMBOL	DESCRIPTION
[K]	*KEY DIMENSION*
[C]	*CRITICAL DIMENSION*

REVISION TABLE				
REV.	DATE	ECN	DESCRIPTION OF CHANGE	BY

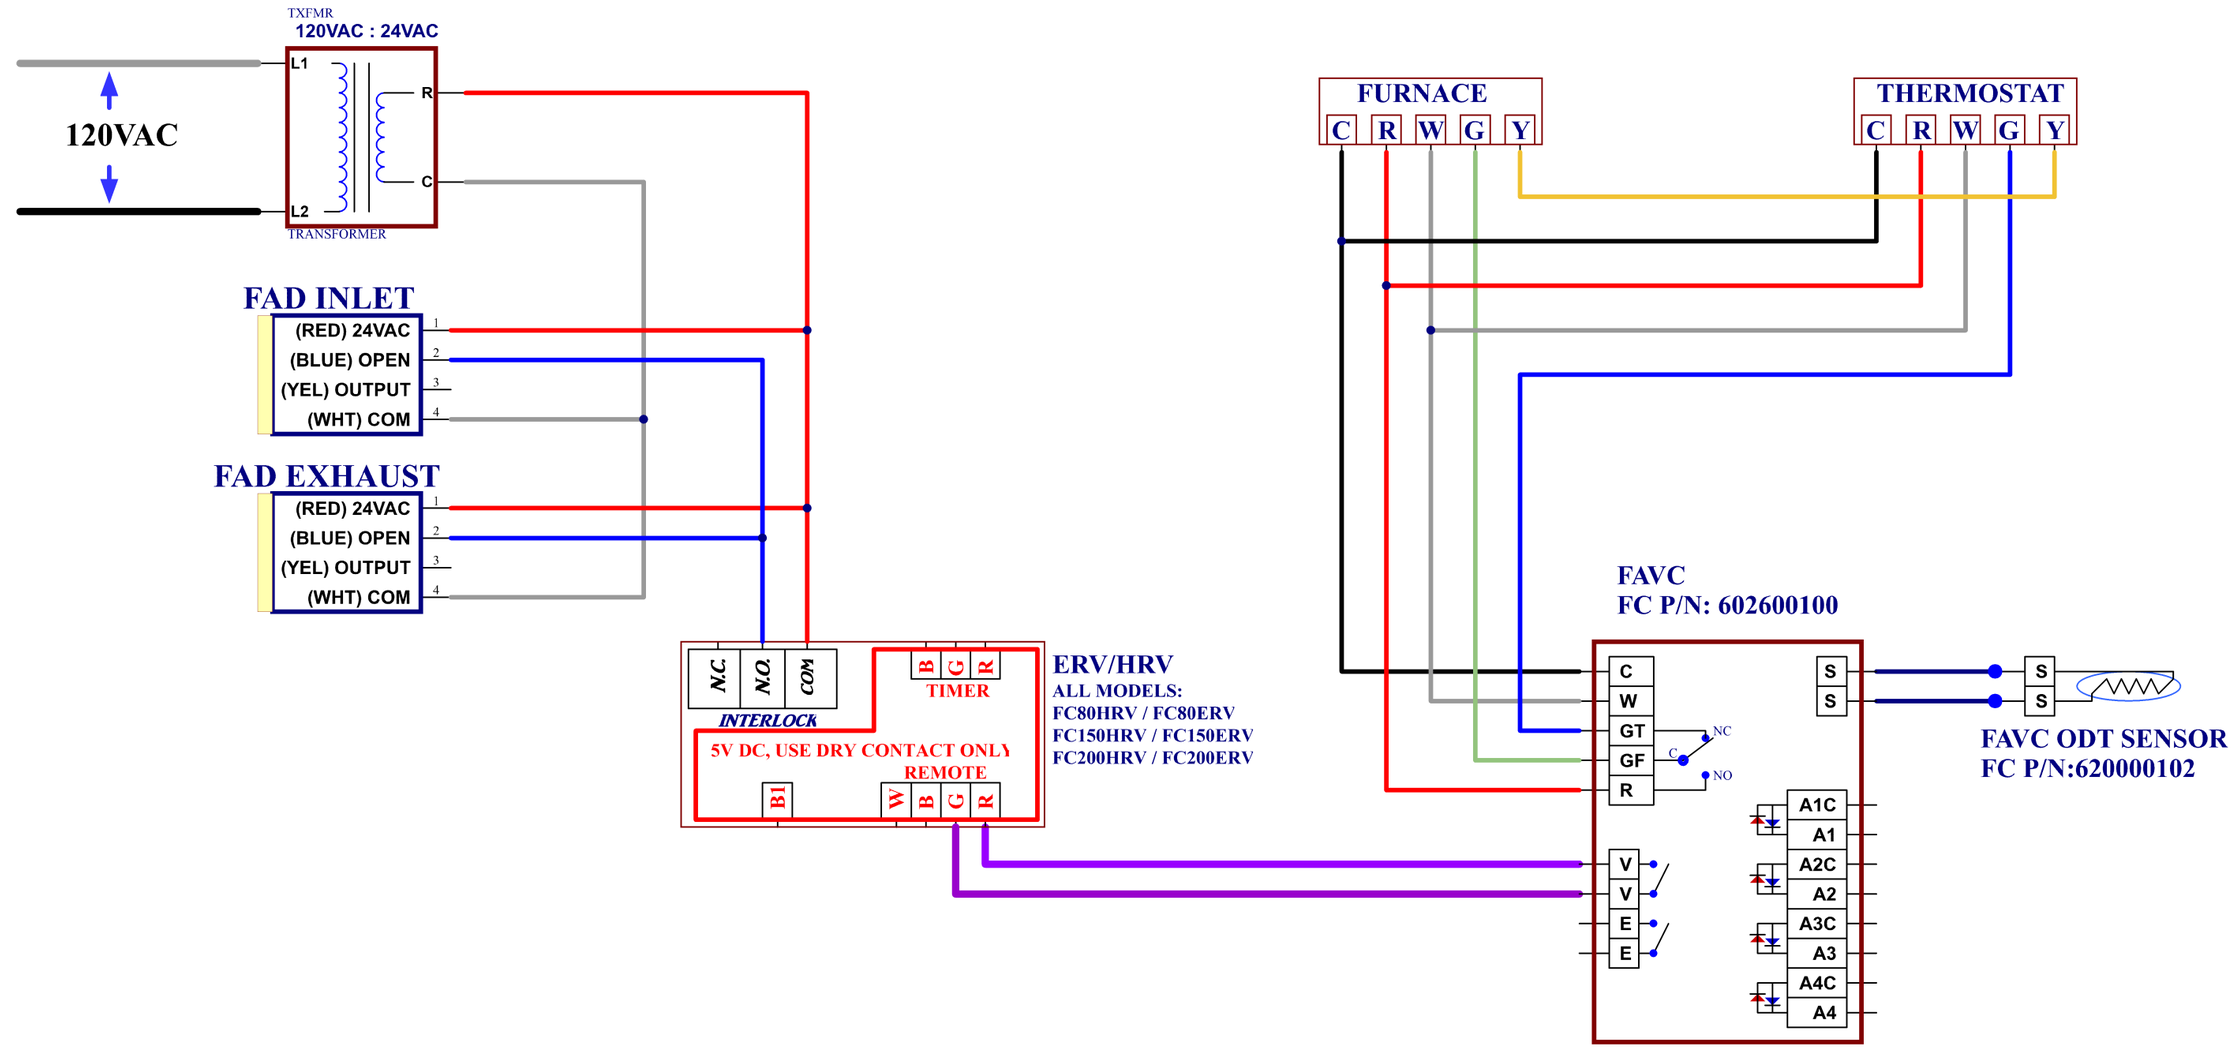

NOTES:

1. HRV/ERV WILL CONTROL THE FAD INLET AND EXHAUST DAMPERS. IF THE HRV/ERV CONTROL SWITCH IS SET TO CONTINUOUS, BOTH DAMPERS WILL OPEN. THE REMOTE CONTROL FROM THE FAVC WILL CHANGE FAN SPEED OF THE HRV/ERV.
2. IF THE HRV/ERV CONTROL SWITCH IS SET TO INTERMITTENT, THE FAVC WILL ACTIVATE THE HRV/ERV. DAMPERS WILL OPEN WHEN REMOTE CONTROL ACTIVATES THE HRV/ERV.
3. IF THE HRV/ERV CONTROL SWITCH IS SET TO OFF, THE DAMPERS WILL CLOSE.
4. IF THE HRV/ERV POWER CORD IS UNPLUGGED, THE DAMPERS WILL CLOSE.
5. VENTILATION WILL OCCUR ONLY IF THE HRV/ERV HAS POWER AND IS TURNED ON.

FIELD CONTROLS
KINSTON, N.C
28504
USA

TOLERANCE (UNLESS NOTED)	
FRACTIONAL:	Ñ 1/32
ANGLES:	Ñ 2Á
X.X DECIMAL:	Ñ 0.050
X.XX DECIMAL:	Ñ 0.010
X.XXX DECIMAL:	Ñ 0.005

DESCRIPTION: FAVC WITH HRV/ERV WITH DUAL FRESH AIR DAMPERS FOR INLET AND EXHAUST

ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE SPECIFIED

P/N:	REV:
780300914	A

ORIG ECN	REV ECN	SHEET	DWN BY:	DATE:	APVD BY:	DATE:
0407	-	1:1	EAH	10/10/2018	MRL	10/10/2018

THIS DOCUMENT IS THE PROPERTY OF FIELD CONTROLS LLC AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED OR DISCLOSED WITHOUT THE EXPRESS AUTHORIZATION OF FIELD CONTROLS LLC.

FILE NAME: 780300914.SLDDRW