


Wiring Diagrams

for Oil Vent Damper

Warm Air Furnace with OVD and Honeywell ST9103 Control Board

Black, Orange, and Yellow wires from Vent Damper MUST be the same polarity or product damage will occur.

OVD WITH ELECTRONIC PRIMARY CONTROL

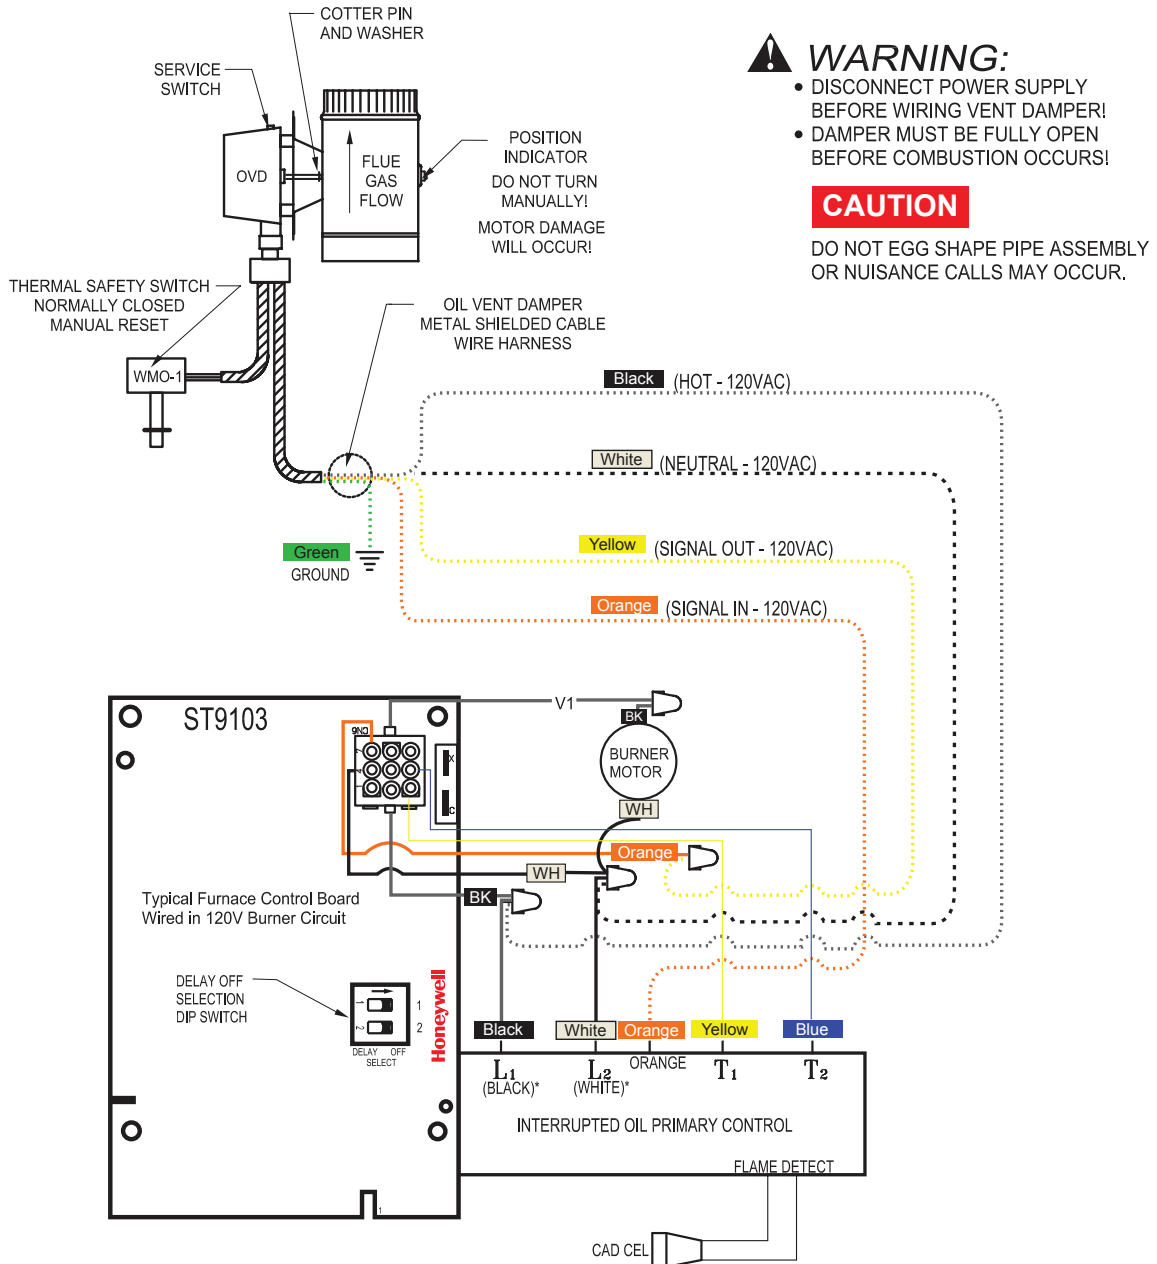

..... LINE VOLTAGE BY QUALIFIED AGENCY
 ——— LINE VOLTAGE BY FACTORY

..... LOW VOLTAGE BY QUALIFIED AGENCY
 ——— LOW VOLTAGE BY FACTORY

WIRENUT